


REVISION No. 9

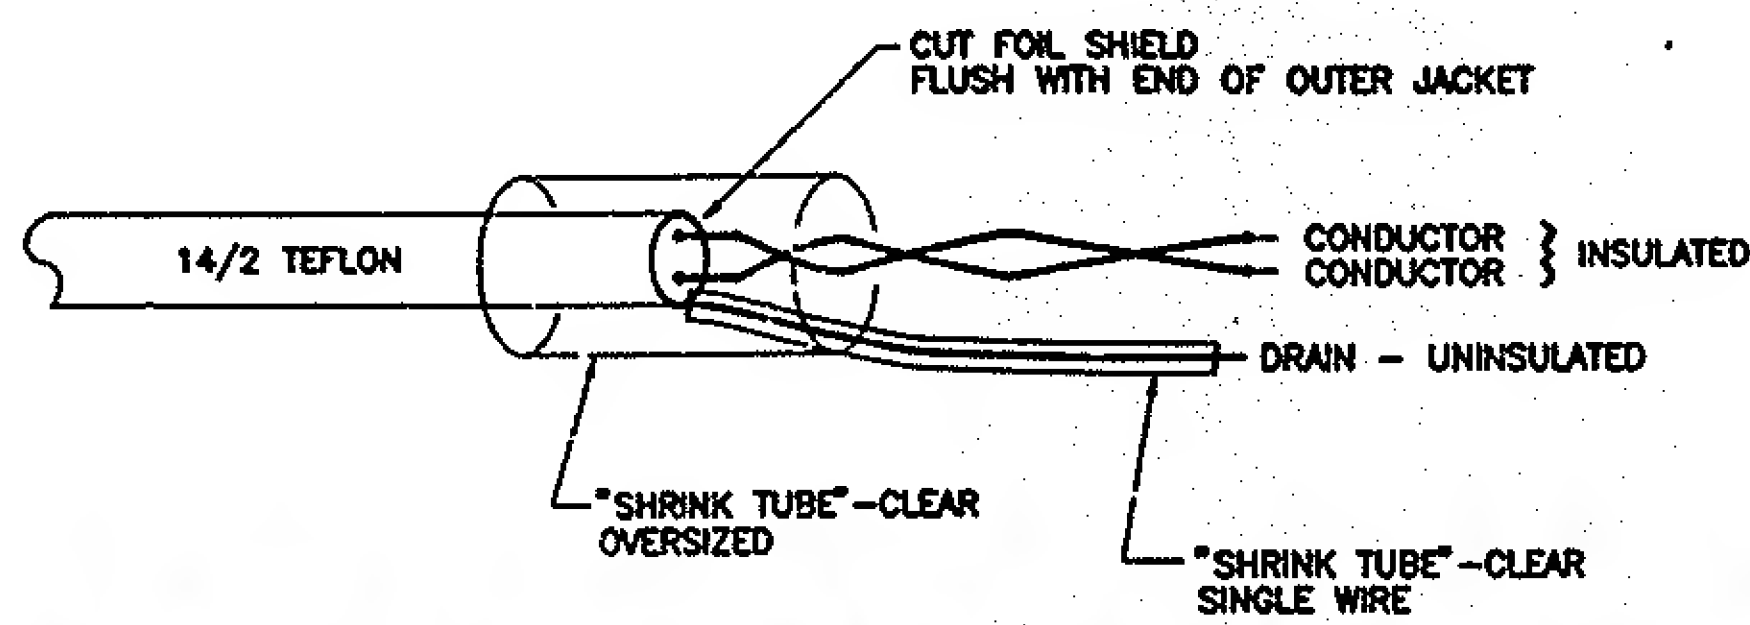

DETAIL 'A' - TYPICAL SHIELD/DRAIN INSULATING METHOD

NOTES:

1. FOR LEGEND, ABBREVIATIONS & GENERAL NOTES, SEE DWG E-1 AND E-2.
2. ALL SHIELDS SHALL BE ISOLATED FROM GROUND. APPROVED "SHRINK" TUBING SHALL BE USED ON ALL DRAIN CONDUCTORS. SEE DETAIL "A" (ON THIS DWG).
3. CONTRACTOR SHALL TERMINATE, TEST AND MAKE FINAL CONNECTION IN NTC-X5 AND NTC-X6.
4. FOR NTC-X5 ENCLOSURE LOCATION, SEE DWG'S E-25 AND E-26.
5. FOR NTC-X6 ENCLOSURE LOCATION, SEE DWG'S E-5 AND E-6.

LEGEND

21UP5
21S5

+ (R) 2

